


2.4GHz Wireless Audio Receiver

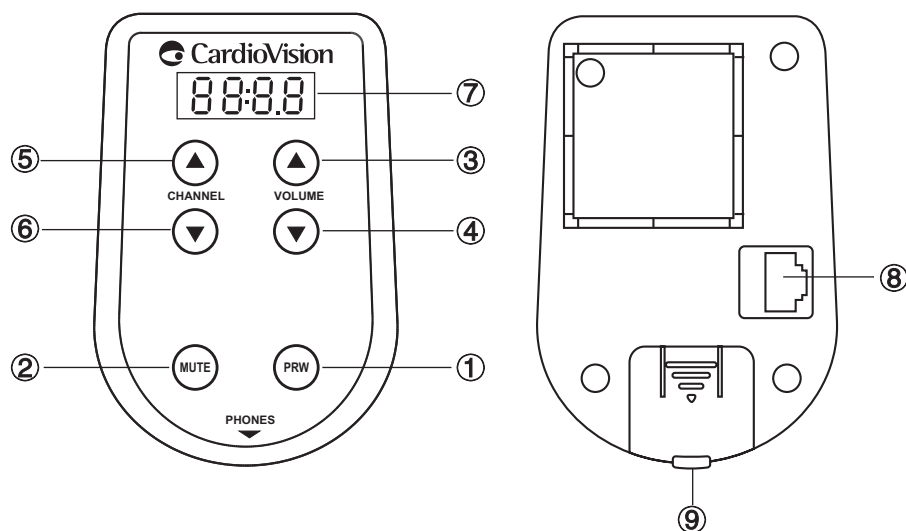

- | | |
|-----------------|--------------------------------------|
| 1. Power Switch | 6. Channel Down |
| 2. Mute | 7. Channel and Volume Level Display |
| 3. Volume Up | 8. RJ45 Connector |
| 4. Volume Down | 9. 3.5mm Stereo Audio Headphone Jack |
| 5. Channel Up | |

CardioVision 2.4 GHz Receiver Installation Instructions:

1. The receiver can be powered by using one of the C-safe ports on your cardio machine or by using an AC power supply. If you are using the C-safe connection, connect one end of the C-safe cable into the C-safe port on the cardio machine and the other into the RJ45 plug (#8 on the diagram) on the back of the receiver unit. If you are using an AC power supply, plug the AC power supply into a standard 110V outlet and then into the RJ45 plug (#8 on the diagram) on the back of the receiver. Route the cord appropriately as not to interfere with any of the functions or safety features of the cardio machine.
2. Attach the receiver unit to the cardio machine in a convenient location on the machine. Use the included cable ties (zip ties) to secure the receiver to the cardio machine. Be very careful in placing the receiver on the machine as you don't want to interfere with any of the moving parts or safety features on the machine. Check the full range of motion, mounting and dismounting the machine before determining the proper placement for the receiver.

Operating Instructions:

- Plug your headphones into the headphone jack (diagram #9) on the receiver.
- Turn the receiver on/off by pressing the "PWR" button (diagram #1). The unit is on when the display window (diagram #7) is lit.
- Use the channel up and down buttons (diagram #'s 5 and 6) to select the channel (CH01 through CH14) that corresponds to the TV program that you would like to listen to.
- Adjust the volume to your comfort by pressing the volume up and down buttons. (diagram #'s 3 and 4) The volume can be adjusted from a range of 01 to 15. When you plug your headphones in and power the receiver up it is set to default to a volume level of 08.
- If you need to turn the volume off at once, press the "MUTE" button. (diagram #2). This will mute the sound until you press the button again at which time the volume level will return to it's previous setting. The display window will "flash" when the sound is muted and shine continuously when playing normally.
- Your CardioVision 2.4GHz receiver is equipped with a replaceable headphone jack for your convenience. If the headphone plug becomes loose; or you notice a degradation in the sound quality, maximum volume level, or a lot of "scratchiness/static", the headphone jack likely needs to be replaced. The headphone jack assembly is located on the back of the receiver unit at the bottom. To replace the jack, simply press the tab with the arrow on the jack assembly and slide the whole assembly toward the bottom of the receiver.
- Replace the whole jack assembly by sliding the new jack into place until it "clicks".

For support or installation questions call CardioVision customer support at:
1-866-993-0900.